
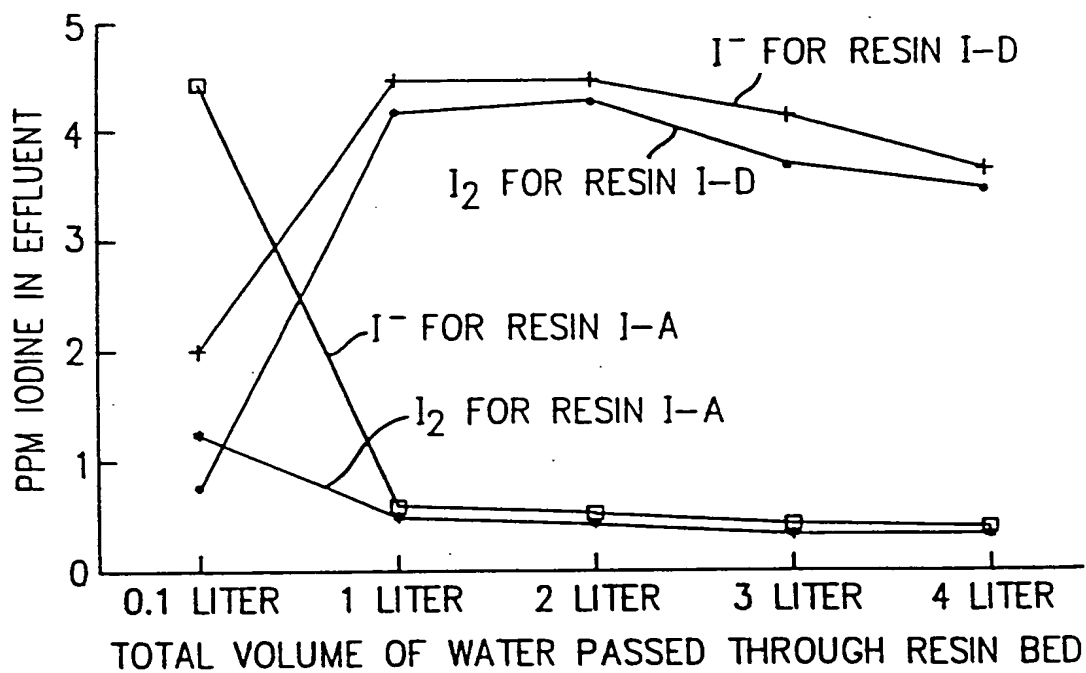


1/7



FIG. 1

CFU/100ml : K.TERRIGENA

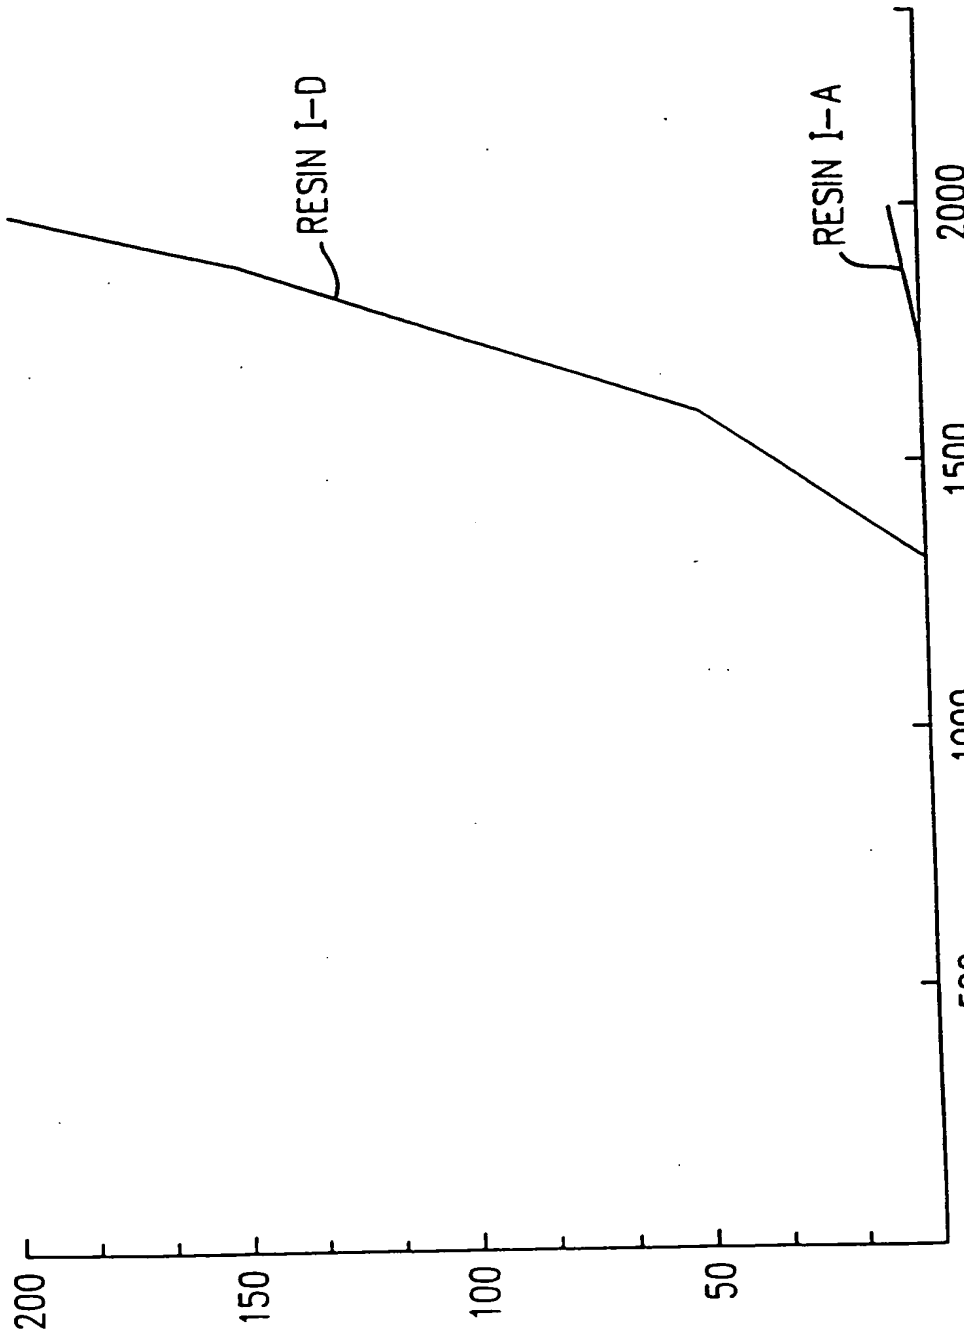

TOTAL VOLUME OF CONTAMINATED WATER CONTACTED
WITH DISINFECTANT RESIN (LITERS)

Fig. 2

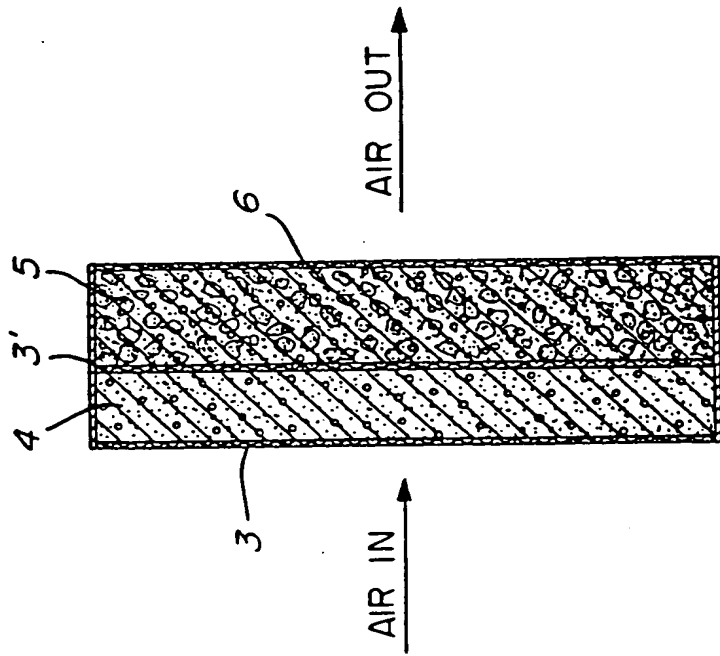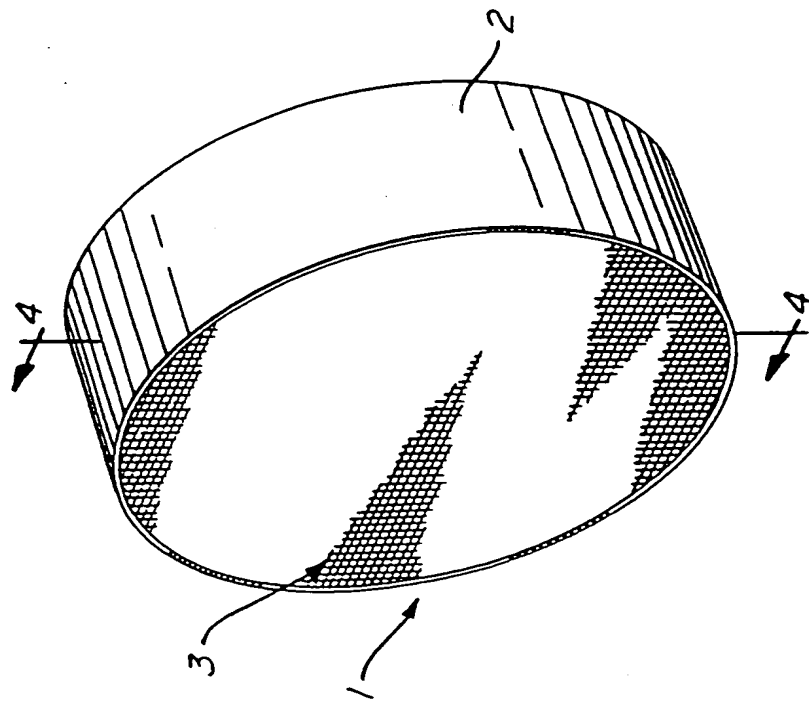

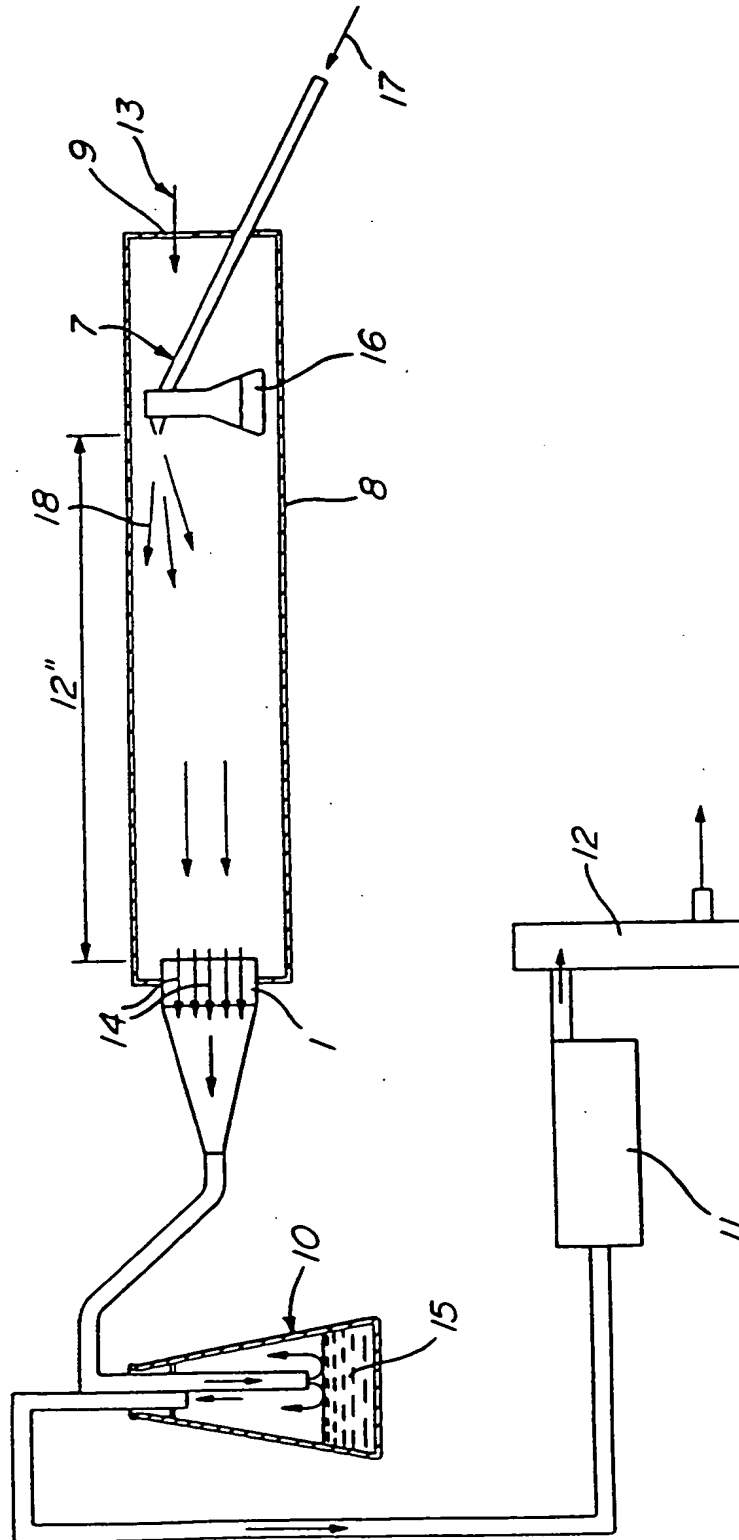


FIG. 5

FIG. 6 is a schematic diagram of the system of FIG. 1, showing the flow of fluid from the pump 11, through the filter 12, into the chamber 1, and out of the chamber 1 through the outlet 17.

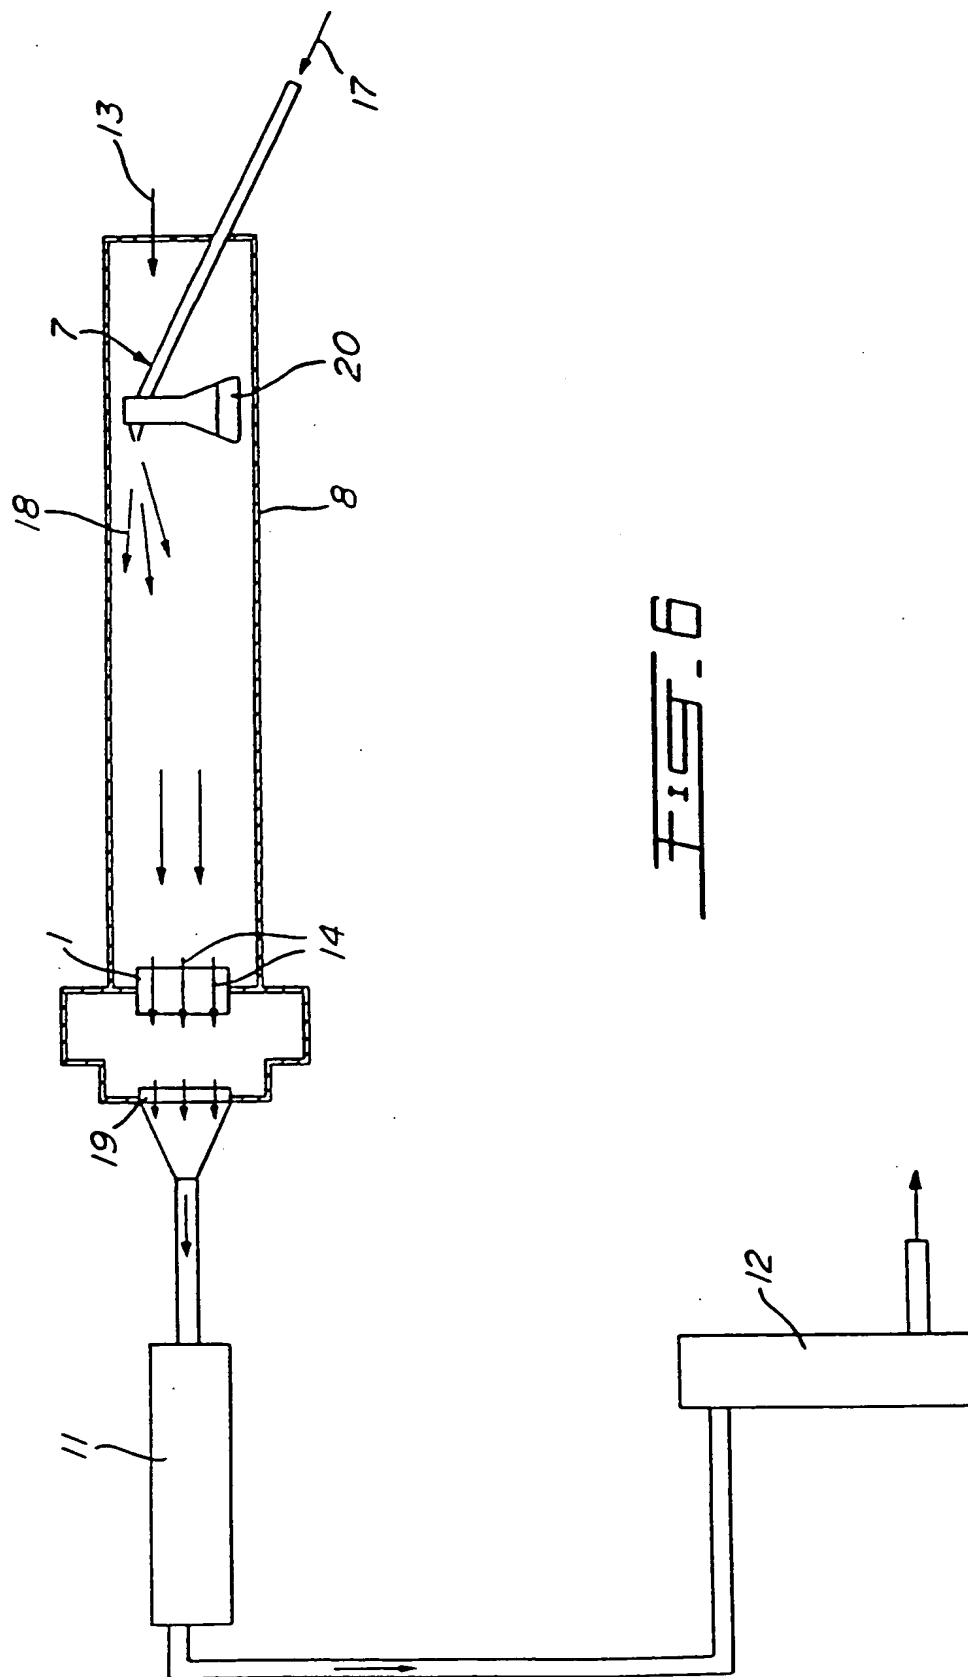


FIG. 6

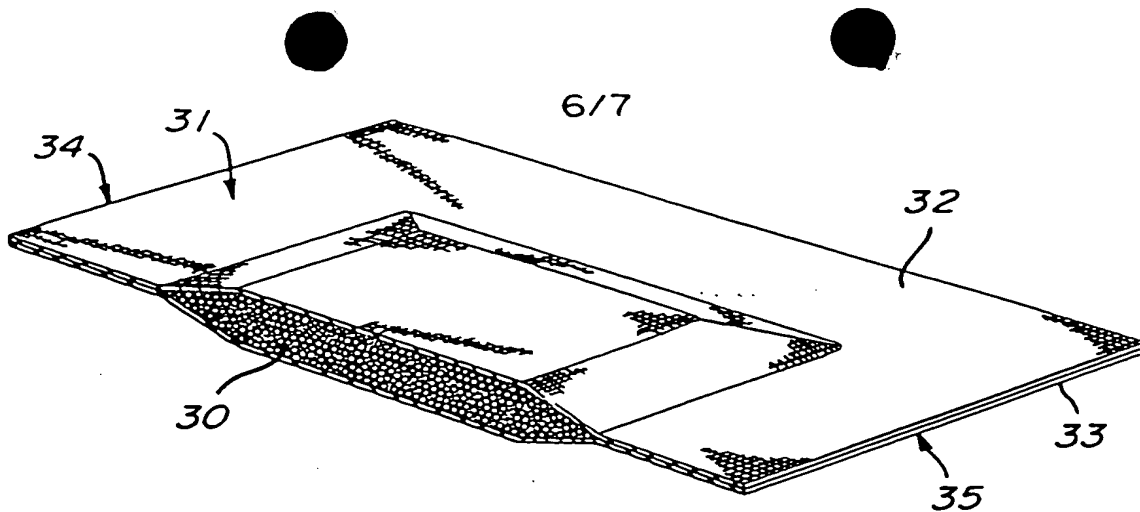


FIG. 7

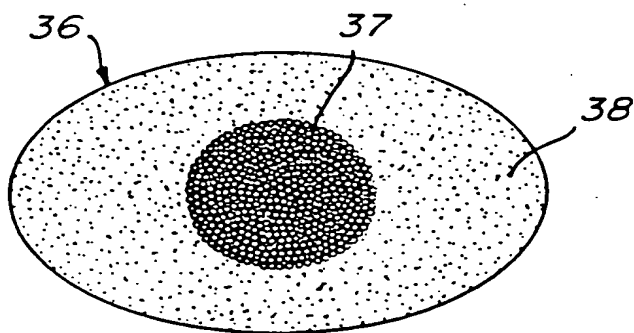
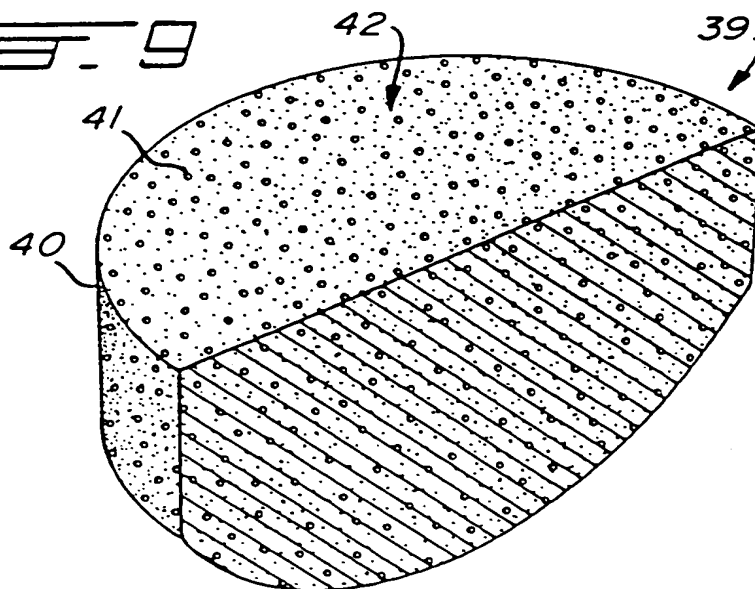


FIG. 8

FIG. 9



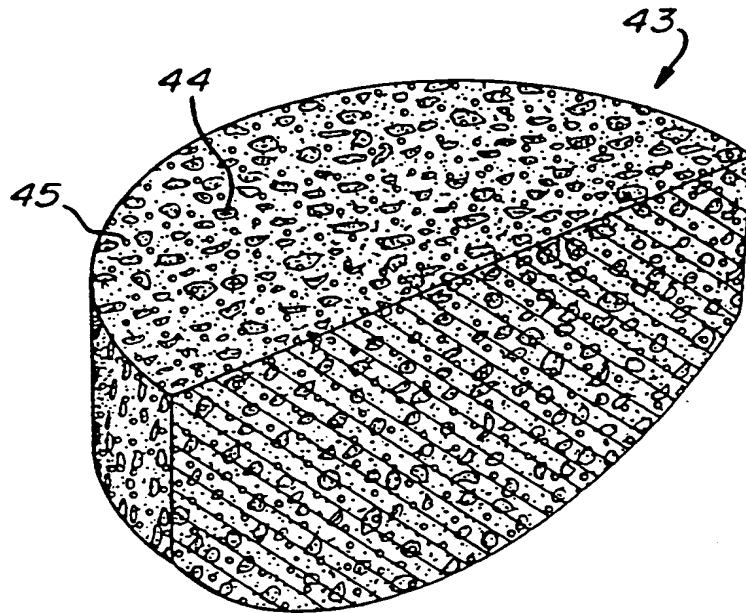


FIG. 10

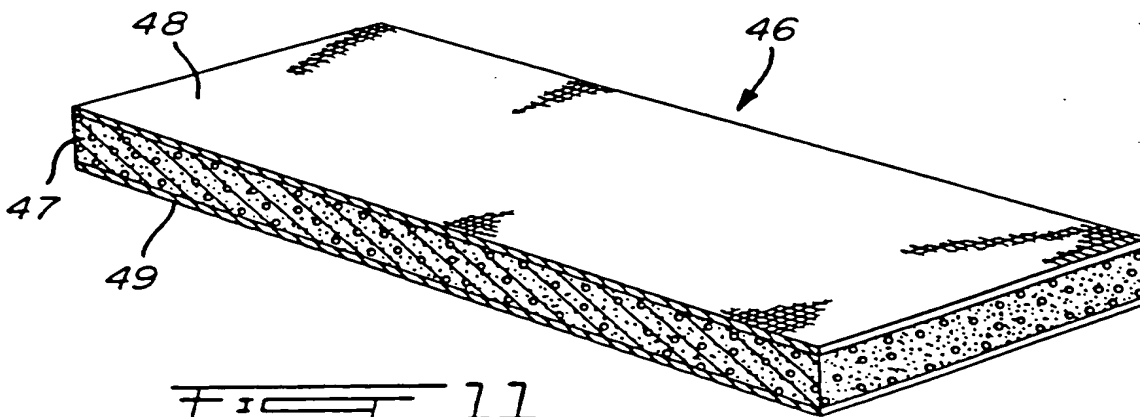


FIG. 11